

NOTES:


The Curb Box shall be placed 1'-0" from the streetedge of the proposed or existing sidewalk/bikepath, or 2 feet inside the right-of-way or easement line when no sidewalk/bikepath is present or proposed.

When a curb box is installed within a traveled area, the contractor shall install a C.I. Ferrule Box per "L-6320".

The Curb Stop Shall Be Installed with Valve Opening Facing the Structure to be served.
The Curb Stop Shall Turn "1/4 Turn" Clockwise From On to Off Position. (Typical)

* NOTE:

Pipe Shall Be Copper Tubing Size (C.T.S.)

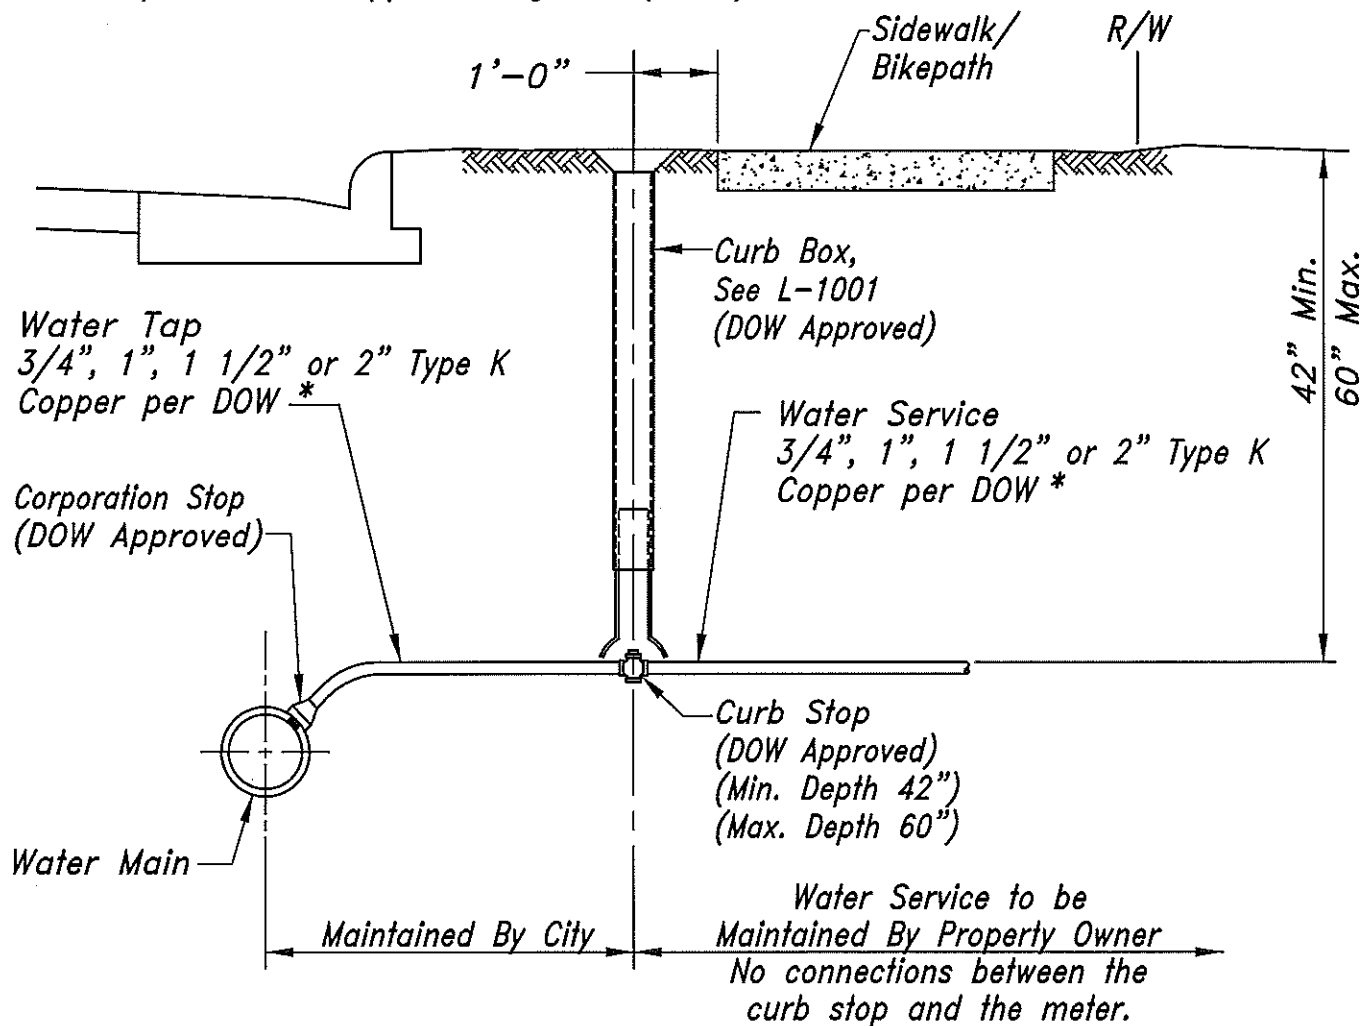

L-9901.Dwg Revision Date: 3/4/13

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER		STANDARD DETAIL	
APPROVED: <i>R.C. Westerfield</i> 5-16-13		CURB BOX INSTALLATION	
ADMINISTRATOR/ DATE		3/4" THRU 2"	